

# *Cementex*

## *The Safety Tool Specialists*

**Insulated 1000V Rated Hand Tools  
Insulating Rubber Goods  
Arc Flash PPE**



WARNING: INSPECT BEFORE USING REMOVE FROM SERVICE  
IF YELLOW LAYER SHOWS THROUGH ORANGE LAYER

# 13.0

Cementex Products Inc.  
650 Jacksonville Rd. • P.O. Box 1533  
Burlington, NJ 08016

[www.cementexusa.com](http://www.cementexusa.com)  
[orders@cementexusa.com](mailto:orders@cementexusa.com) • [rfq@cementexusa.com](mailto:rfq@cementexusa.com)

609.387.1040 • 800.654.1292  
fax: 609.386.8885



# ELECTRICAL SAFETY COMPLIANCE CHART

## FOR NFPA 70E AND CSA Z462

Energized work shall only be performed when permitted by 70E 130.2(A) / Z462 4.3.2.2. For tasks not listed or for power systems with greater than the assumed maximum short circuit current capacity or with longer than the assumed maximum fault clearing times, an arc flash hazard analysis shall be required in accordance with 70E 130.5 / Z462 4.3.5. This summary table is only for use by **QUALIFIED PERSONNEL** that have been trained in accordance with the most current version of NFPA 70E Articles 110, 120 and 130 / CSA Z462 Clause 4.

### Tasks Performed on Energized Equipment (600 volts or less): 70E 130.7(C)(15)(a) / Z462 Table 4A

Table A Panelboards or Other Equipment Rated 240 V and Below <i>Note 1</i>		
Perform infrared thermography and other non-contact inspections outside the restricted approach boundary	LDG	0
Circuit breaker (CB) or fused switch operation with covers on	LDG	0
CB or fused switch operation with covers off	LDG	0
Work on energized electrical conductors and circuit parts, including voltage testing	IG/IT	1
Remove / Install CBs or fused switches	IG/IT	1
Removal of bolted covers (to expose bare, energized electrical conductors and circuit parts)	LDG	1
Opening hinged covers (to expose bare, energized electrical conductors and circuit parts)	LDG	0
Work on energized electrical conductors and circuit parts of utilization equipment fed directly by a branch circuit of the panelboard	IG/IT	1
Table B Panelboards or Switchboards Rated >240 V and up to 600 V (with molded case or insulated case circuit breakers) <i>Note 1</i>		
Perform infrared thermography and other non-contact inspections outside	LDG	1
CB or fused switch operation with enclosure doors closed	LDG	0
CB or fused switch operation with covers off	IG	1
Work on energized electrical conductors and circuit parts, including voltage testing	IG/IT	2
Remove/install CBs or fused switches	IG/IT	2
Removal of bolted covers (to expose bare, energized electrical conductors and circuit parts)	LDG	1
Opening hinged covers (to expose bare, energized electrical conductors and circuit parts)	LDG	0
Work on energized electrical conductors and circuit parts of utilization equipment fed directly by a branch circuit of the panelboard or switchboard	IG/IT	2
Table C Other 600 V Class (277 V through 600 V nominal) Equipment <i>Note 2 (except as indicated)</i>		
Lighting or small power transformers (600 V maximum)		
Removal of bolted covers (to expose bare, energized electrical conductors and circuit parts)	LDG	2
Opening hinged covers (to expose bare, energized electrical conductors and circuit parts)	LDG	1
Application of safety grounds, after voltage test	IG	2
Work on energized electrical conductors and circuit parts, including voltage testing	IG/IT	2
Revenue meters (kW-hour, at primary voltage and current) Insertion or removal	IG	2
Cable trough or tray cover removal or installation	LDG	1
Miscellaneous equipment cover removal or installation	LDG	1
Work on energized electrical conductors and circuit parts, including voltage testing	IG/IT	2
Application of safety grounds, after voltage test	IG	2
Insertion or removal of plug-in devices into or from busways	IG	2

Table D 600 V Class Motor Control Centers (MCCs) <i>Note 2 (except as indicated)</i>		
Perform infrared thermography and other non-contact inspections outside the restricted approach boundary	LDG	1
CB or fused switch or starter operation with enclosure doors closed	LDG	0
Reading a panel meter while operating a meter switch	LDG	0
CB or fused switch or starter operation with enclosure doors open	LDG	1
Work on energized electrical conductors and circuit parts, including voltage testing	IG/IT	2
Work on control circuits with energized electrical conductors and circuit parts 120 V or below, exposed	IG/IT	0
Work on control circuits with energized electrical conductors and circuit parts 120 V or above, exposed	IG/IT	2
Insertion or removal of individual starter "buckets" from MCC— <i>Note 3</i>	IG	4
Application of safety grounds, after voltage test	IG	2
Removal of bolted covers — <i>Note 3</i> (to expose bare, energized electrical conductors and circuit parts)	LDG	4
Opening hinged covers — <i>Note 3</i> (to expose bare, energized electrical conductors and circuit parts)	LDG	1
Work on energized electrical conductors and circuit parts of utilization equipment fed directly by a branch circuit of the motor control center	IG/IT	2
Table E 600 V Class Switchgear (with power circuit breakers or fused switches) <i>Note 4</i>		
Perform infrared thermography and other non-contact inspections outside the restricted approach boundary	LDG	2
CB or fused switch operation with enclosure doors closed	LDG	0
Reading a panel meter while operating a meter switch	LDG	0
CB or fused switch operation with enclosure doors open	LDG	1
Work on energized electrical conductors and circuit parts, including voltage testing	IG/IT	2
Work on control circuits with energized electrical conductors and circuit parts 120 V or below, exposed	IG/IT	0
Work on control circuits with energized electrical conductors and circuit parts 120 V or above, exposed	IG/IT	2
Insertion or removal (racking) of CBs from cubicles, doors open or closed	LDG	4
Application of safety grounds, after voltage test	IG	2
Removal of bolted covers (to expose bare, energized electrical conductors and circuit parts)	LDG	4
Opening hinged covers (to expose bare, energized electrical conductors and circuit parts)	LDG	2
Table X* Hazard Risk Categories that are Known to be Extremely Dangerous		
480V Building Service Entrance Equipment	IG/IT	4+
Equipment on 480V/secondary side of an Ind/Comm substation	IG/IT	4+
All equipment on the load side of circuit breakers containing a short-time delay setting. Temporary removal of short time-delay is recommended.	IG/IT	4+

**\*The above areas are known to commonly equal or exceed a HRC4; calculations should be done prior to energized work**

#### General Notes : (applicable to the tasks that are 600 volts or less)

- Insulating rubber gloves are gloves rated for the maximum line-to-line voltage upon which work will be done.
- Insulated tools rated and tested for the maximum line-to-line voltage upon which work will be done, and are manufactured and tested in accordance with ASTM F1505 & CAN/ULC-D60900, Standard Specification for Insulated and Insulating Hand Tools: 1000VAC / 1500VDC
- For systems rated less than 1000 volts, the fault currents and upstream protective device clearing times are based on an 18 in. working distance.
- For equipment protected by upstream current limiting fuses with arcing fault current in their current limiting range (1/2 cycle fault clearing time or less), the hazard/risk category required may be reduced by one number.)

#### Specific Notes: (as referenced within the tables)

- Max. of 25 kA short circuit current available; max. of 0.03 sec (2 cycle) fault clearing time: min. 18" working Potential arc flash boundary with exposed energized conductors or circuit parts using above parameters: 19"
- Max. of 65 kA short circuit current available; max. of 0.03 sec (2 cycle) fault clearing time: min. 18" working Potential arc flash boundary with exposed energized conductors or circuit parts using above parameters: 53"
- Max. of 42 kA short circuit current available; max. of 0.33 sec (20 cycle) fault clearing time: min. 18" working Potential arc flash boundary with exposed energized conductors or circuit parts using above parameters: 165"
- Max. of 35 kA short circuit current available; max. of up to 0.5 sec (30 cycle) fault clearing time: min. 18" working Potential arc flash boundary with exposed energized conductors or circuit parts using above parameters: 233"

#### Notes:

- A complete ARC FLASH HAZARD ANALYSIS should be done, if fault clearing times vary from those described within the **Specific Notes**, rendering these tables alone **INSUFFICIENT**.
- IG/IT** indicates the required use of insulating rubber gloves, leather protectors & insulated tools.
- IG** indicates a requirement for the use of insulating rubber gloves and leather protectors.
- LDG** indicates a requirement of leather gloves.
- Hazard Risk Category (HRC) is defined in the last column, by one of five categories 0, 1, 2, 3 & 4 (0 being the least dangerous and 4 being the most dangerous)

CLOTHING AND/OR EQUIPMENT 70E 130.7 (C)(16) / Z462 Table 5	HRC 0	HRC 1	HRC 2	HRC 3	HRC 4
Arc Thermal Protective Value in Cal/cm <sup>2</sup> (minimum)	0	1	2	3	40
Non-melting/untreated natural fiber long-sleeve shirt	X	--	--	--	--
Non-melting/untreated natural fiber long pants	X	--	--	--	--
Arc-rated long-sleeve shirt	--	X	X	X	X
Arc-rated pants	--	X	X	X	X
Arc-rated coverall	--	X	X	X	X
Arc-rated arc flash suit jacket	--	X	X	X	X
Arc-rated arc flash suit pants	--	X	X	X	X
Arc-rated arc flash suit hood	--	X	X	X	X
Arc-rated jacket, parka or rainwear	--	AN	AN	AN	AN
Hard hat	--	X	X	X	X
Safety glasses or goggles	X	X	X	X	X
Hearing protection	X	X	X	X	X
Leather gloves	AN	X	X	X	X
Leather work shoes	--	X	X	X	X

#### NOTES: 70E 130.7(C)(16) / Z462 Table 5

- Arc rating for garments is expressed in calories per centimeter squared (cal/cm<sup>2</sup>)
- When rubber insulating gloves (IG) with leather protectors are required by NFPA 70E 130.7(C)(15)(a) / CSA Z462 Table 4A, additional leather gloves or arc-rated gloves shall not be required.
- An alternate to arc rated shirts and pants in HRC 1 or HRC 2 is an arc rated coveralls with minimum of 4 cal/cm<sup>2</sup> for HRC 1 and minimum of 8 cal/cm<sup>2</sup> for HRC 2
- Face shields are required for HRC 1 (4 cal/cm<sup>2</sup>) and HRC 2 (8 cal/cm<sup>2</sup>) requires the use of balaclava/sock and wrap-around guarding to protect face, forehead, ears and neck with a minimum of 8 cal/cm<sup>2</sup>. Alternatively an appropriately arc-rated flash suit hood may be used.
- Minimum arc rating of 25 is required for HRC 3 which can be accomplished using a total FR clothing system [shirt and pants and/or coveralls and/or coat and pant] and hood.
- Minimum arc rating of 40 is required for HRC 4 which can be accomplished using a total FR clothing system [shirt and pants and/or coveralls and/or coat and pant] and hood.



# Cementex

## Insulating Technology


Cementex has spent over 50 years perfecting the insulation of hand tools. We've developed our own proprietary insulation material that provides the safest, most durable insulation for your protection. Painsstaking attention to detail is part of our process; ensuring every tool is of the highest level of quality when it leaves our factory in Burlington, NJ. Each tool is individually inspected, tested and guaranteed to be manufactured to the level you deserve.



**▲ RATED**  
 1000 VAC ⚡ 1500 VDC  
 LIFETIME MECHANICAL WARRANTY\*  
 2 YEAR INSULATION WARRANTY\*

## Composite Technology

While we've spent a long time perfecting an insulating coating, we are continuously developing new technologies to improve safety, durability, and usability. This pursuit is evident in our Composite Driver Tools. By eliminating 95% of all conductive material and utilizing cutting edge technology, we have created drivers that are strong, light-weight, durable, and most importantly, safe.

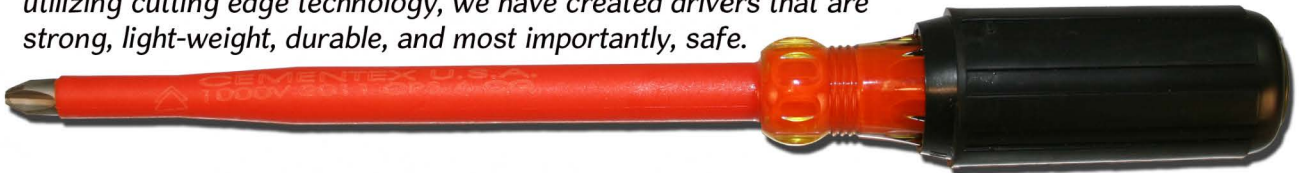

**▲ RATED**  
 1000 VAC ⚡ 1500 VDC  
 LIFETIME WARRANTY\*

## Limited Lifetime Warranty

Our commitment to quality enables us to offer an unparalleled warranty. The Cementex Limited Lifetime Warranty guarantees the mechanical parts of the tools for life, provided they are used for the purpose for which they are intended.

Insulation is guaranteed to be free from defects in material and workmanship for a period of two (2) years from the date of the shipment. Insulation is guaranteed to pass a 10,000 VAC proof test in accordance with applicable U.S. and International Standards and rated for application to 1000 VAC / 1500 VDC.

Prior to each use, each insulated tool is to be inspected for cuts, cracks, or other damage. If the yellow insulation becomes visible through the orange outer layer, the tool is not repairable and must be removed from service immediately. Insulated tools are to be used as secondary protection and are not meant to be used in place of other personal protective equipment. Cuts, cracks, or other damage to the tool insulation caused by usage of the tool is not covered under warranty.

Torque Wrench repairs are covered by warranty so long as the torque wrench is within its annual calibration timeframe.



# Insulated Hand Tools - Where and When

## “OSHA - Electrical, Safeguards for personal protection 1910.335(a)(2)(i)

When working near exposed energized conductors or circuit parts, each employee shall use insulated tools or handling equipment if the tools or handling equipment might make contact with such conductors or parts...”

## “2012 Edition NFPA 70E® STANDARD for Electrical Safety in the Workplace®


### 130.7(D)(1) Insulated Tools and Equipment.

Employees shall use insulated tools or handling equipment, or both, when working inside the **limited approach boundary** of exposed energized electrical conductors or circuit parts where tools or handling equipment might make accidental contact...”

### “def. Boundary, Limited Approach

An approach limit at a distance from an exposed energized electrical conductor or circuit part within which a shock hazard exists.”

ex. \*Limited Approach Boundary  
Exposed Fixed conductors  
50V - 750V AC = 3ft 6in  
100V - 1kV DC = 3ft 6in

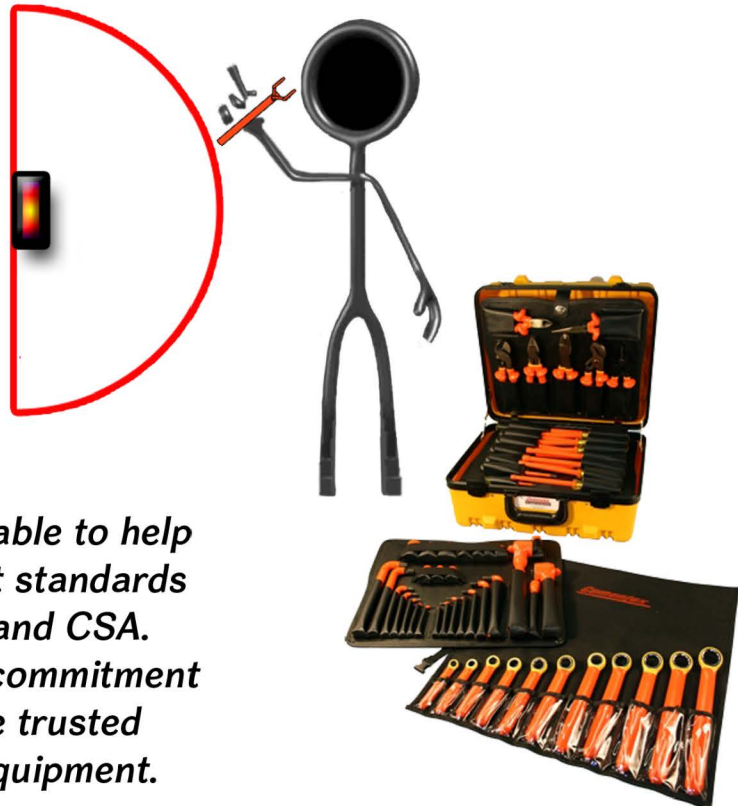

*Cementex has the tools available to help you comply with the stringent standards established by OSHA, NFPA, and CSA. Knowledge, experience, and commitment to quality make Cementex the trusted source for safety tools and equipment.*

\*2012 NFPA 70E® Tables 130.4 (C)(a), 130.4(C)(b)

# Nut Drivers

- Slender Insulation at Head for access to tight locations
- Cushion Grip (CG) handle for greater comfort and torque
- Plating for corrosion resistance
- Internal Flanges in handle provide solid, twist-resistant blade



ND120-CGXL



CND916-CG



ND120ASB

ND120A

## -Angled

PN	DESC
ND516A.....	5/16"
ND380A.....	3/8"
ND716A.....	7/16"
ND716ASB...	7/16" Short Barrel
ND120A.....	1/2"
ND120ASB...	1/2" Short Barrel
ND916A.....	9/16"
ND916ASB...	9/16" Short Barrel
ND580A.....	5/8"
ND580ASB..	5/8" Short Barrel
ND340A.....	3/4"
ND340ASB..	3/4" Short Barrel

## SAE

PN	DESC
ND316-CG.....	3/16" X 3"
ND316CGXL.....	3/16" X 6"
ND732-CG.....	7/32" X 3"
ND732-XLCG...	7/32" X 6"
ND140-CG.....	1/4" X 3"
ND140CGXL.....	1/4" X 6"
ND932-CG.....	9/32" X 3"
ND516-CG.....	5/16" X 3"
ND516CGXL.....	5/16" X 6"
ND516CGXXL...	5/16" X 18"
ND1132-CG.....	11/32" X 3"
ND1132CGXL.....	11/32" X 6"
ND380-CG.....	3/8" X 3"
ND380CGXL.....	3/8" X 6"
ND380CGXXL...	3/8" X 8 1/2"
ND716-CG.....	7/16" X 3"
ND716CGXL.....	7/16" X 6"
ND120-CG.....	1/2" X 3"
ND120CGXL.....	1/2" X 6"
ND916-CG.....	9/16" X 3"
ND916CGXL.....	9/16" X 6"
ND580-CG.....	5/8" X 3"
ND580CGXL.....	5/8" X 6"
ND340CG.....	3/4" X 3"

## Metric

PN	DESC
ND4MM-CG.....	4mm X 3"
ND4.5MM-CG.....	4.5mm X 3"
ND5MM-CG.....	5mm X 3"
ND5MM-CGXL.....	5mm X 6"
ND5.5MM-CG.....	5.5mm X 3"
ND6MM-CG.....	6mm X 3"
ND6MM-CGXL.....	6mm X 6"
ND7MM-CG.....	7mm X 3"
ND7MM-CGXL.....	7mm X 6"
ND8MM-CG.....	8mm X 3"
ND8MM-CGXL...	8mm X 6"
ND9MM-CG.....	9mm X 3"
ND9MM-CGXL.....	9mm X 6"
ND10MM-CG.....	10mm X 3"
ND10MM-CGXL..	10mm X 6"
ND11MM-CG.....	11mm X 3"
ND11MM-CGXL...	11mm X 6"
ND12MM-CG.....	12mm X 3"
ND12MM-CGXL..	12mm X 6"
ND13MM-CG.....	13mm X 3"
ND13MM-CGXL..	13mm X 6"

## Composite

PN	DESC
CND316-CG3...	3/16" X 3"
CND316-CG.....	3/16" X 6"
CND140-CG3...	1/4" X 3"
CND140-CG.....	1/4" X 6"
CND516-CG3...	5/16" X 3"
CND516-CG.....	5/16" X 6"
CND1132-CG3..	11/32" X 3"
CND1132-CG.....	11/32" X 6"
CND380-CG3...	3/8" X 3"
CND380-CG.....	3/8" X 6"
CND716-CG3...	7/16" X 3"
CND716-CG.....	7/16" X 6"
CND120-CG3...	1/2" X 3"
CND120-CG.....	1/2" X 6"
CND916-CG3...	9/16" X 3"
CND916-CG.....	9/16" X 6"
CND580-CG.....	5/8" X 6"

# Holding Screwdrivers

- "Split-Blade" Design
- Rigid Composite Sleeve
- Plating for corrosion resistance
- Cushion Grip (CG) handle for greater comfort and torque
- Available in multiple sizes and bit tip configurations



CPSBMP1



PN	DESC
CPSB1204....	1/8" X 4" OAL 6"
CPSB1206....	1/8" X 6" OAL 8"
CPSB1208....	1/8" X 8" OAL 10"
CPSB1704....	3/16" X 4" OAL 6.5"
CPSB1706....	3/16" X 6" OAL 8.5"
CPSB1708....	3/16" X 8" OAL 10.5"
CPSB1734....	3/16" X 6"
CPSB1736....	3/16" X 8"
CPSB1804....	3/16" X 4"
CPSB1806....	3/16" X 6" OAL 9.75"
CPSB1808...	3/16" X 8" OAL 11.75"
CPSB2304...	1/4" X 4"
CPSB2306...	1/4" X 6" OAL 9.75"
CPSB2308...	1/4" X 8" OAL 11.75"
CPSB2356...	1/4" X 10"
CPSBMP1.....	#2 X 6" Phillips CG

# Holding Screw and Nut Starters

- Spring-Loaded Design allows for easy operation while wearing insulating gloves
- Slender Design for tight area access and storage
- Composite includes opposing end magnet for retrieval
- Available in multiple sizes and bit tip configurations



G2NS



G2NS-SBY



CD11-8



D11PTSH

## Composite

PN	DESC
CD3-8.....	8" Flat Tip
CD11-8.....	8" Phillips Tip
CDNS-8...	8" Nut Starter

PN	DESC
D2FTSH.....	3/16" X 9-3/4" Flat Tip
D3FT-SBY....	1/4" X 4" Flat Tip "Stubby"
D3FTSH.....	1/4" X 9-3/4" Flat Tip
D10PTSH.....	#2 X 6" Phillips Tip
D11PT-SBY...	#2 X 4" Phillips Tip "Stubby"
D11PTSH.....	#2 X 9-3/4" Phillips Tip
F2PTSS.....	Universal Screwstarter
G2NS.....	Holding Nut Starter
G2NS-SBY... 4"	"Stubby" Holding Nut Starter