


SEU/SER/SE

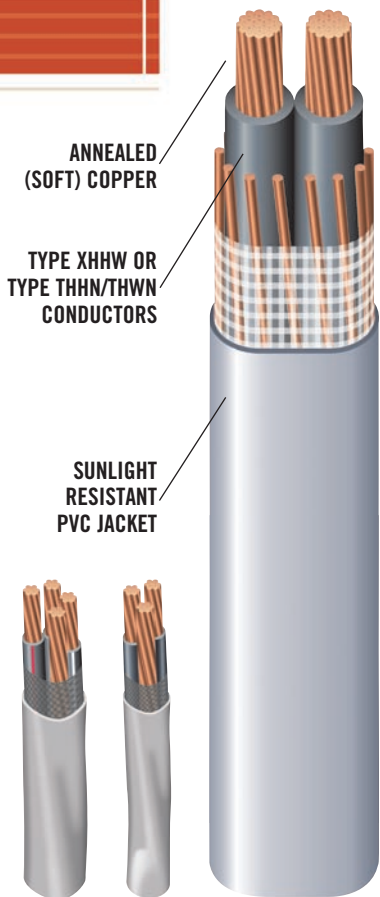

**Service Entrance Cable,
Type SE, Style U**

600 Volt

**Copper Conductors
Individual Conductors**

**Rated XHHW-2 or
THHN/THWN**

**Copper Concentric
Neutral**

**Jacket and Individual
Conductors Sunlight
Resistant**

APPLICATIONS Suitable for use as follows:

Southwire Type SE, service entrance cable is primarily used to convey power from the service drop to the meter base and from the meter base to the distribution panelboard; however, the cable may be used in all applications where Type SE cable is permitted. SER may be used in wet or dry locations at temperatures not to exceed 90°C. Voltage rating is 600 volts.

STANDARDS & REFERENCES

Southwire Type SE cable meets or exceeds UL Standard 44 for XHHW-2 conductors or UL 83 for THHN/THWN conductors, UL Standard 854, Federal Specification A-A-59544, and requirements of the National Electrical Code¹.


CONSTRUCTION

Southwire Type cable is constructed with sunlight resistant Type XHHW-2 conductors or Type THHN/THWN conductors. Copper conductors are annealed (soft) copper. Cable assembly plus reinforcement tape are jacketed with sunlight resistant gray polyvinyl chloride (PVC). Available as 1 conductor with a concentric ground, 2 conductor with a round or concentric ground, or 3 conductor with a bare ground. SE cable is jacketed with gray sunlight resistant polyvinyl chloride (PVC).

SPECIFICATIONS

Cable shall be UL-listed Type SE, Style U, suitable for operation at 600 volts or less in all installations as specified in the National Electrical Code. Conductors shall be annealed copper, Type XHHW-2 or Type THHN/THWN, weather resistant PVC jacketed, as manufactured by Southwire Company or approved equal.

¹2005 Edition.



COPPER CONDUCTORS

SEU/SER/SE

WEIGHTS, MEASUREMENTS AND PACKAGING

CONDUCTOR	COPPER								
	STRANDING		NOMINAL O.D. (mils)	ALLOWABLE AMPACITIES*				APPROX. NET WEIGHT PER 1000' (lbs)	STANDARD PACKAGE
	PHASE CONDUCTORS & NEUTRAL	EQUIPMENT GROUND CONDUCTOR		60°C	75°C	90°C	DWELLING		
SER TWO CONDUCTOR WITH BARE GROUND (FORMERLY REFERRED TO AS "THREE CONDUCTOR")									
8-8-8	7	--	586	40	50	55	-	236	B
6-6-6	7	--	669	55	65	75	-	342	B
4-4-4	7	--	771	70	85	95	100	499	B
3-3-3	7	--	829	85	100	110	110	611	B
2-2-2	7	--	896	95	115	130	125	752	B
1-1-1	19	--	1021	110	130	150	150	947	C
1/0-1/0-1/0	19	--	1106	125	150	170	175	1168	C
2/0-2/0-2/0	19	--	1201	145	175	195	200	1444	C
3/0-3/0-3/0	19	--	1309	165	200	225	225	1791	C
4/0-4/0-4/0	19	--	1430	195	230	260	250	2226	C
SER THREE CONDUCTOR WITH BARE GROUND (FORMERLY REFERRED TO AS "FOUR CONDUCTOR")									
8-8-8-8	7	7	645	40	50	55	-	291	B
6-6-6-6	7	7	738	55	65	75	-	428	B
4-4-4-6	7	7	852	70	85	95	100	586	B
3-3-3-5	7	7	917	85	100	110	110	720	B
2-2-2-4	7	7	992	95	115	130	125	888	B
1-1-1-3	19	7	1132	110	130	150	150	1118	C
1/0-1/0-1/0-2	19	7	1226	125	150	170	175	1382	C
2/0-2/0-2/0-1	19	19	1332	145	175	195	200	1714	C
3/0-3/0-3/0-1/0	19	19	1453	165	200	225	225	2130	C
4/0-4/0-4/0-2/0	19	19	1588	195	230	260	250	2651	C

Table values reflect Type XHHW-2 conductors.

*Allowable Ampacities:

Allowable ampacities shown are for general use as specified by the National Electrical Code, 2008 Edition, section 310.15.

60°C – When terminated to equipment for circuits rated 100 amperes or less or marked for 14 through 1 AWG conductors.

75 °C – When terminated to equipment for circuits rated over 100 amperes or marked for conductors larger than 1 AWG.

90°C – Wet or dry locations. For ampacity derating purposes.

Dwelling – For dwelling units, conductors shall be permitted at listed ampacities as 120/240-volt, 3-wire, single-phase services and feeders.

STANDARD PACKAGE CODE:

B – 1000 ft. reel


C – 500 ft. reel

SEU/SER/SE

WEIGHTS, MEASUREMENTS AND PACKAGING									
CONDUCTOR	COPPER								
SIZE/CONST. (AWG)	STRANDING		NOMINAL O.D. (mils)	ALLOWABLE AMPACITIES*				APPROX. NET WEIGHT PER 1000' (lbs)	STANDARD PACKAGE
	PHASE CONDUCTORS	BARE GROUND		60°C	75°C	90°C	DWELLING		
SEU ONE CONDUCTOR WITH A BARE CONCENTRIC GROUND (FORMERLY REFERRED TO AS "TWO CONDUCTOR")									
8-8	7	8	400	40	50	55	-	146	BH
6-6	7	12	435	55	65	75	-	210	BH
4-4	7	12	506	70	85	95	-	314	BI
2-2	7	15	580	95	115	130	-	485	BJ
SEU TWO CONDUCTOR WITH A BARE CONCENTRIC GROUND (FORMERLY REFERRED TO AS THREE CONDUCTOR)									
10-10-10	1	12	419 X 270	30	30	30	-	126	BH
8-8-8	7	8	57 X 366	40	50	55	-	210	BH
6-6-6	7	12	650 X 402	55	65	75	-	307	BJ
4-4-4	7	12	815 X 506	70	85	95	100	471	BJ
3-3-3	7	12	874 X 534	85	100	110	110	582	BJ
2-2-2	7	15	935 X 565	95	115	130	125	717	BL
1-1-1	19	14	1084 X 650	110	130	150	150	903	CL
1/0-1/0-1/0	19	18	1162 X 689	125	150	170	175	1121	CM
2/0-2/0-2/0	19	18	1266 X 749	145	175	195	200	1377	CM
3/0-3/0-3/0	19	14	1412 X 845	165	200	225	225	1711	CM
4/0-4/0-4/0	19	18	1524 X 901	195	230	260	250	2145	CM
SEU TWO CONDUCTOR WITH A BARE CONCENTRIC GROUND (FORMERLY REFERRED TO AS "THREE CONDUCTOR") (REDUCED NEUTRAL)									
6-6-8	7	8	650 X 402	55	65	75	-	280	BI
4-4-6	7	12	781 X 468	70	85	95	100	419	BJ
3-3-5	7	15	834 X 494	85	100	110	110	514	BJ
2-2-4	7	12	920 X 549	95	115	130	125	638	BL
<p>Table values reflect Type XHHW-2 conductors</p> <p>*Allowable Ampacities: Allowable ampacities shown are for general use as specified by the National Electrical Code, 2008 Edition, section 310.15. 60°C – When terminated to equipment for circuits rated 100 amperes or less or marked for 14 through 1 AWG conductors. 75°C – When terminated to equipment for circuits rated over 100 amperes or marked for conductors larger than 1 AWG. 90°C – Wet or dry locations. For ampacity derating purposes Dwelling – For dwelling units, conductors shall be permitted at listed ampacities as 120/240-volt, 3-wire, single-phase services and feeders.</p>							<p>STANDARD PACKAGE CODE:</p> <p>B – 1000 ft. reel C – 500 ft. reel H – 250 ft. reel I – 200 ft. coil J – 150 ft. coil L – 100 ft. coil M – 50 ft. coil</p>		



SEU/SER/SE

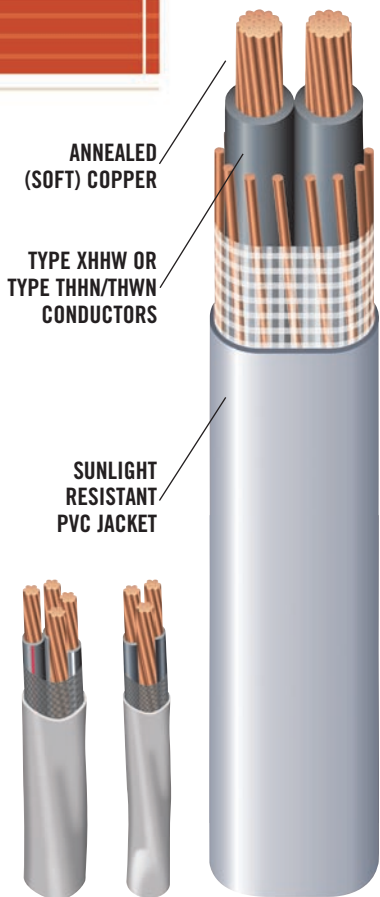

**Service Entrance Cable,
Type SE, Style U**

600 Volt

**Copper Conductors
Individual Conductors**

**Rated XHHW-2 or
THHN/THWN**

**Copper Concentric
Neutral**

**Jacket and Individual
Conductors Sunlight
Resistant**

APPLICATIONS Suitable for use as follows:

Southwire Type SE, service entrance cable is primarily used to convey power from the service drop to the meter base and from the meter base to the distribution panelboard; however, the cable may be used in all applications where Type SE cable is permitted. SER may be used in wet or dry locations at temperatures not to exceed 90°C. Voltage rating is 600 volts.

STANDARDS & REFERENCES

Southwire Type SE cable meets or exceeds UL Standard 44 for XHHW-2 conductors or UL 83 for THHN/THWN conductors, UL Standard 854, Federal Specification A-A-59544, and requirements of the National Electrical Code¹.


CONSTRUCTION

Southwire Type cable is constructed with sunlight resistant Type XHHW-2 conductors or Type THHN/THWN conductors. Copper conductors are annealed (soft) copper. Cable assembly plus reinforcement tape are jacketed with sunlight resistant gray polyvinyl chloride (PVC). Available as 1 conductor with a concentric ground, 2 conductor with a round or concentric ground, or 3 conductor with a bare ground. SE cable is jacketed with gray sunlight resistant polyvinyl chloride (PVC).

SPECIFICATIONS

Cable shall be UL-listed Type SE, Style U, suitable for operation at 600 volts or less in all installations as specified in the National Electrical Code. Conductors shall be annealed copper, Type XHHW-2 or Type THHN/THWN, weather resistant PVC jacketed, as manufactured by Southwire Company or approved equal.

¹2005 Edition.



COPPER CONDUCTORS

SEU/SER/SE

WEIGHTS, MEASUREMENTS AND PACKAGING

CONDUCTOR	COPPER									
	STRANDING			NOMINAL O.D. (mils)	ALLOWABLE AMPACITIES*				APPROX. NET WEIGHT PER 1000' (lbs)	STANDARD PACKAGE
	PHASE CONDUCTORS & NEUTRAL	EQUIPMENT GROUND CONDUCTOR	60°C		75°C	90°C	DWELLING			
SER TWO CONDUCTOR WITH BARE GROUND (FORMERLY REFERRED TO AS "THREE CONDUCTOR")										
8-8-8	7	--	586	40	50	55	-	236	B	
6-6-6	7	--	669	55	65	75	-	342	B	
4-4-4	7	--	771	70	85	95	100	499	B	
3-3-3	7	--	829	85	100	110	110	611	B	
2-2-2	7	--	896	95	115	130	125	752	B	
1-1-1	19	--	1021	110	130	150	150	947	C	
1/0-1/0-1/0	19	--	1106	125	150	170	175	1168	C	
2/0-2/0-2/0	19	--	1201	145	175	195	200	1444	C	
3/0-3/0-3/0	19	--	1309	165	200	225	225	1791	C	
4/0-4/0-4/0	19	--	1430	195	230	260	250	2226	C	
SER THREE CONDUCTOR WITH BARE GROUND (FORMERLY REFERRED TO AS "FOUR CONDUCTOR")										
8-8-8-8	7	7	645	40	50	55	-	291	B	
6-6-6-6	7	7	738	55	65	75	-	428	B	
4-4-4-6	7	7	852	70	85	95	100	586	B	
3-3-3-5	7	7	917	85	100	110	110	720	B	
2-2-2-4	7	7	992	95	115	130	125	888	B	
1-1-1-3	19	7	1132	110	130	150	150	1118	C	
1/0-1/0-1/0-2	19	7	1226	125	150	170	175	1382	C	
2/0-2/0-2/0-1	19	19	1332	145	175	195	200	1714	C	
3/0-3/0-3/0-1/0	19	19	1453	165	200	225	225	2130	C	
4/0-4/0-4/0-2/0	19	19	1588	195	230	260	250	2651	C	

Table values reflect Type XHHW-2 conductors.

*Allowable Ampacities:

Allowable ampacities shown are for general use as specified by the National Electrical Code, 2008 Edition, section 310.15.

60°C – When terminated to equipment for circuits rated 100 amperes or less or marked for 14 through 1 AWG conductors.

75 °C – When terminated to equipment for circuits rated over 100 amperes or marked for conductors larger than 1 AWG.

90°C – Wet or dry locations. For ampacity derating purposes.

Dwelling – For dwelling units, conductors shall be permitted at listed ampacities as 120/240-volt, 3-wire, single-phase services and feeders.

STANDARD PACKAGE CODE:

B – 1000 ft. reel

C – 500 ft. reel

SEU/SER/SE

WEIGHTS, MEASUREMENTS AND PACKAGING

CONDUCTOR SIZE/CONST. (AWG)	COPPER								
	STRANDING		NOMINAL O.D. (mils)	ALLOWABLE AMPACITIES*				APPROX. NET WEIGHT PER 1000' (lbs)	STANDARD PACKAGE
	PHASE CONDUCTORS	BARE GROUND		60°C	75°C	90°C	DWELLING		
SEU ONE CONDUCTOR WITH A BARE CONCENTRIC GROUND (FORMERLY REFERRED TO AS "TWO CONDUCTOR")									
8-8	7	8	400	40	50	55	-	146	BH
6-6	7	12	435	55	65	75	-	210	BH
4-4	7	12	506	70	85	95	-	314	BI
2-2	7	15	580	95	115	130	-	485	BJ
SEU TWO CONDUCTOR WITH A BARE CONCENTRIC GROUND (FORMERLY REFERRED TO AS THREE CONDUCTOR)									
10-10-10	1	12	419 X 270	30	30	30	-	126	BH
8-8-8	7	8	57 X 366	40	50	55	-	210	BH
6-6-6	7	12	650 X 402	55	65	75	-	307	BJ
4-4-4	7	12	815 X 506	70	85	95	100	471	BJ
3-3-3	7	12	874 X 534	85	100	110	110	582	BJ
2-2-2	7	15	935 X 565	95	115	130	125	717	BL
1-1-1	19	14	1084 X 650	110	130	150	150	903	CL
1/0-1/0-1/0	19	18	1162 X 689	125	150	170	175	1121	CM
2/0-2/0-2/0	19	18	1266 X 749	145	175	195	200	1377	CM
3/0-3/0-3/0	19	14	1412 X 845	165	200	225	225	1711	CM
4/0-4/0-4/0	19	18	1524 X 901	195	230	260	250	2145	CM
SEU TWO CONDUCTOR WITH A BARE CONCENTRIC GROUND (FORMERLY REFERRED TO AS "THREE CONDUCTOR") (REDUCED NEUTRAL)									
6-6-8	7	8	650 X 402	55	65	75	-	280	BI
4-4-6	7	12	781 X 468	70	85	95	100	419	BJ
3-3-5	7	15	834 X 494	85	100	110	110	514	BJ
2-2-4	7	12	920 X 549	95	115	130	125	638	BL

Table values reflect Type XHHW-2 conductors

*Allowable Ampacities:

Allowable ampacities shown are for general use as specified by the National Electrical Code, 2008 Edition, section 310.15.

60°C – When terminated to equipment for circuits rated 100 amperes or less or marked for 14 through 1 AWG conductors.

75°C – When terminated to equipment for circuits rated over 100 amperes or marked for conductors larger than 1 AWG.

90°C – Wet or dry locations. For ampacity derating purposes

Dwelling – For dwelling units, conductors shall be permitted at listed ampacities as 120/240-volt, 3-wire, single-phase services and feeders.

STANDARD PACKAGE CODE:

- B – 1000 ft. reel
- C – 500 ft. reel
- H – 250 ft. reel
- I – 200 ft. coil
- J – 150 ft. coil
- L – 100 ft. coil
- M – 50 ft. coil

